




smokecenturion™ smoke

NEW!

* SILICONE FREE TESTING

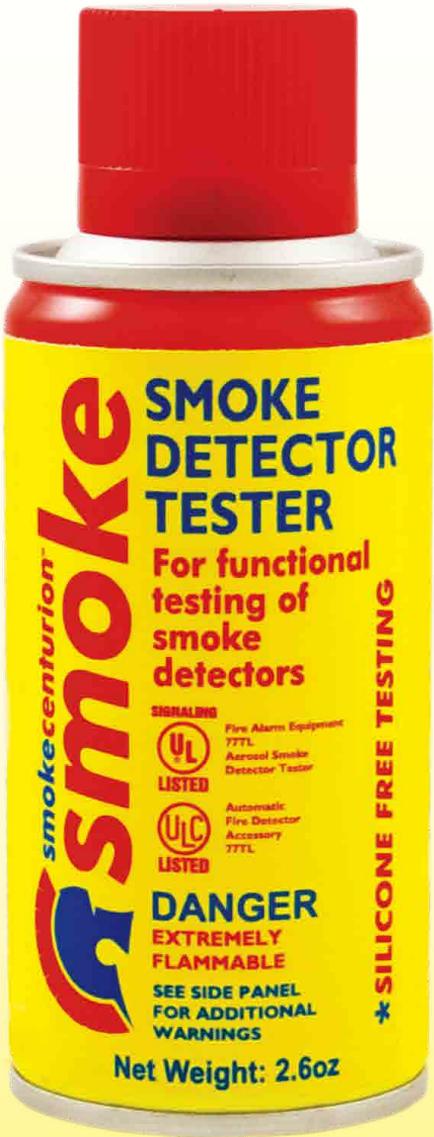

- More tests per can
- Fast detector activation
- Lowest cost per test
- Either hand-held or with use of a dispenser
- Silicone-free testing, reduces risk of detector contamination
- High eco responsibility: ozone friendly (no CFCs) and low GWP propellant
- Formula approved by leading detector manufacturers
- UL / ULC Listed



www.sdifire.com

SIGNALING



Fire Alarm Equipment
77TL
Aerosol Smoke
Detector Tester



Automatic
Fire Detector
Accessory
77TL

smokecenturion™ conforms to the following codes:

"...the detectors shall be tested in place to ensure smoke entry into the sensing chamber and an alarm response"

NFPA 72 Chapter 14 (14.4.2.2 (g))

"Each detector shall be tested for operation by introducing smoke or simulated smoke into the detecting chamber."

"le fonctionnement de chaque détecteur de fumée doit être vérifié par l'introduction de fumée ou de fumée simulée dans la chambre de détection, conformément aux instructions du fabricant."

CAN/ULC-S536-04, 5.7.4.1.2