

SUBMITTAL RECORD

JOB _____
 LOCATION _____
 SUBMITTED TO _____
 SUBMITTAL PREPARED BY _____
 APPROVED BY _____
 DATE _____




Submittal Form
Teflon
MCT444 (#10279)
Flexible Duct Connector
TDC/TDF 4" x 4" x 4"

DESCRIPTION

All air duct installations for heating, cooling or ventilation are attached to mechanical equipment containing a fan or blower. Vibrations, noises and rattles resulting from operation of the fan or blower are transmitted into the metal ducts which carry the noises throughout the system.

In order to isolate the vibration and noises to the source, an air - tight flexible joint, consisting of a fabric which is attached to sheet metal on both side, must be inserted between the equipment and the ductwork. This vibration isolator is called a "Flexible Duct Connector".

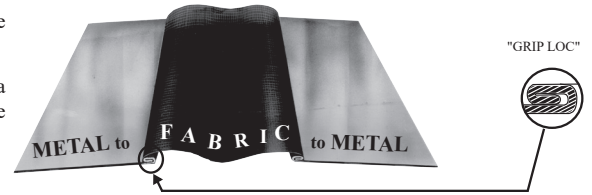

Continuous Temp. Range	-150°F. to 500°F
Color	Grey Outside/Beige Inside
Weight Per Square Yard	16.5 oz
Abrasion Resistance ¹	1000 cycles
Leakage Resistance ²	650
Tear Strength ³	50/30
Tensile Strength ⁴	400/300
ASTM E84 Rating (Flame/Smoke)	0/0
NFPA 701	No

FEATURES

- High temperature resistant
- High corrosion resistance
- Excellent chemical resistance

Notes:

1. Abrasion resistance as per Federal Test Standard 191 Method #5306 using CS 17 wheel with 250 Gram load.
2. Leakage resistance as per Federal Test Standard 191 Method #5512. Results in P.S.I. (To convert inches of water multiply P.S.I. x 27.176).
3. Tear strength in tongue pounds as per Federal Test Standard 191 Method #5134.1 (warp/fill).
4. Tensile strength in grab pounds as per Federal Test Standard 191 Method #5100 (warp/fill).

intertek
 Total Quality. Assured.

TEST REPORT FOR DURO DYNE CORPORATION
 Report No.: 103945724SAT-004
 Date: 5/28/19

SECTION 8
TEST RESULTS

TEST RESULTS	
Test Date	5/24/19
Test Operator	Joseph Martinez
Flame Spread Index (FSI)	0
Smoke Developed Index (SDI)	0
Heptane Calibration (% * Min)	76.8

TEST DATA	
FSI (unrounded)	0.0
SDI (unrounded)	0.13
FS * Time Area (Ft * Min)	0.0
Smoke Area (% * Min)	0.1
Total Fuel Burned (Cubic Ft.)	42.88
Max Flame Front Advance (Ft.)	0.0
Time to Max Flame Front (sec)	0
Max Temp At Exposed T/C (°F)	549
Time To Max Temp (sec)	600


TEST OBSERVATIONS	
Transient Ignition Time	1:01

All Metal-Fab, Super Metal-Fab and TDC/TDF Flexible Duct Connectors are manufactured with 24 gauge galvanized steel. Duro Dyne meets or exceeds the SMACNA steel requirements for flexible duct connector.

SUGGESTED SPECIFICATION

Vibration Isolating Flexible Duct Connector For Heating, Cooling & Exhaust Supplies & Returns.

At the inlet and discharge of all air handling equipment (unless otherwise noted) furnish and install vibration isolators. Vibration isolators shall be a coated woven fabric named Teflon and shall be "Underwriters Laboratories Classified". Vibration isolators shall have a tear strength of not less than 50/30, and a continuous temperature range of -150°F. to 500°F. Vibration isolators shall be preassembled metal to exposed fabric to metal. Fabric and metal shall be joined by means of a double lock seam. Vibration isolators shall be code **MCT444** (called Flexible Duct Connectors) as manufactured by Duro Dyne Corporation, Bay Shore, N.Y.

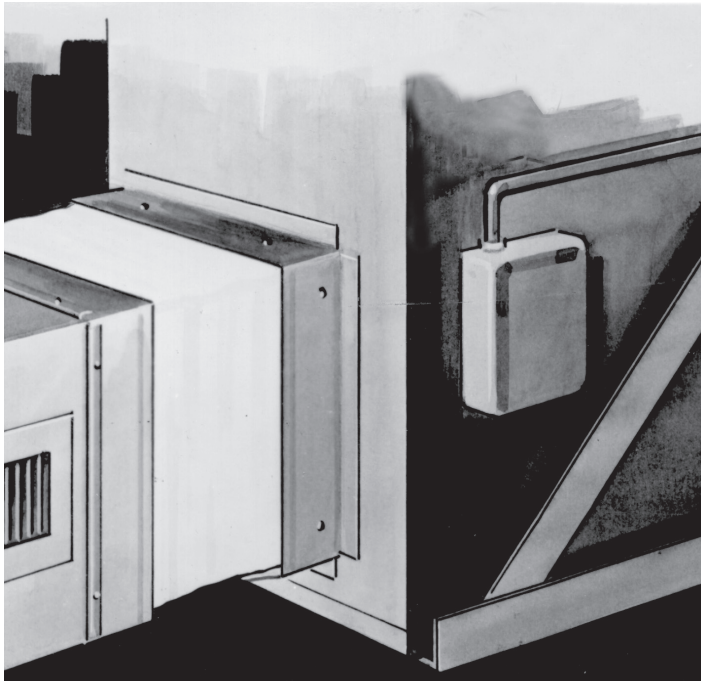

Specifications

All Listed Duro Dyne Flexible Duct Connector Fabrics are designed to meet the following specifications:

1. MIL-C-20696B Para. 4.4.3. (Oil Resistance).
2. MIL-C-20696B Para. 4.4.4. (Hydro Carbon Resistance).
3. NFPA701 Tests for Flame Propagation of Fabrics and film (except Teflon).
4. California State Fire Marshal Approved.
5. Denver City Approved.

All Duro Dyne Flexible Duct Connectors utilize galvanized steel meeting ASTM-A-525 G 60 or better.

Duro Dyne Flexible Duct Connectors are also available with 300 series stainless steel or 3003 aluminum upon request.

CHEMICAL RESISTANCE

(X = Extremely Resistant)

(NR = Not Recommended)

(O = No Data Available)

Chemical	Teflon	Chemical	Teflon
Acetic Acid	X	Hydrofluoric Acid (100%)	X
Aluminum Chloride	X	Hydrogen Peroxide	NR
Aluminum Sulfate	X	Hydrogen Sulfide	X
Ammonia (Anhyd)	X	Lactic Acid	X
Ammonium Hydroxide	X	Linseed Oil	O
Ammonium Sulfate	X	Magnesium Chloride	X
Barium Sulfide	X	Maleic Acid	O
Black Sulfate Liquor	X	Methyl Alcohol	X
Boric Acid	X	Methyl Cellosolve	O
Butyl Alcohol	X	Mineral Oil	X
Cadmium Plating Solution	O	Naptha	X
Calcium Chloride	X	Nickel Chloride	X
Calcium Hypochlorite	X	Nickel Sulfate	X
Chlorine Water	O	Nitric Acid (40%)	X
Chromic Acid	X	Oleic Acid	X
Chromium Plating Solution	O	Oleum	X
Citric Acid	X	Oxalic Acid	X
Copper Chloride	X	Phosphoric Acid (85%)	X
Copper Sulfate	X	Pickling Solution	O
Cottonseed Oil	O	Potassium Chloride	O
Diacetone Alcohol	O	Potassium Cyanide	X
Disodium Phosphate	O	Potassium Dichromate	X
Ethyl Alcohol	X	Potassium Hydroxide (40%)	X
Ethylene Glycol	X	Potassium Sulfate	X
Ferric Chloride	X	Propyl Alcohol	O
Ferric Sulfate	X	Sodium Chloride	X
Fluoroboric Acid	O	Sodium Hydroxide (40%)	X
Formaldehyde (40%)	X	Sodium Hypochlorite	X
Formic Acid	X	Steam	X
Glucose	X	Sulfur Dioxide (Liquid)	X
Glycerine	X	Sulfuric Acid (50%)	X
Heptane	X	Sulfuric Acid (over 50%)	X
Hexane	X	Tannic Acid	X
Hydrobromic Acid (40%)	X	Vinegar	X
Hydrochloric Acid (conc)	X		

Duro Dyne Corporate Headquarters, Bay Shore, NY
631-249-9000 • Fax: 631-249-8346

Duro Dyne Midwest • Duro Dyne West • Duro Dyne Canada
www.durodyne.com • E-mail: durodyne@durodyne.com



©2019 Duro Dyne Corporation
Printed in USA 6/21/19
BO010424